



Farabaugh Engineering and Testing Inc.

Project No. T207-06

Report Date: July 28, 2006

No. Pages: 19 (inclusive)


**TAS 125-03 (ASTM E 1592-01)
STANDARD REQUIREMENTS FOR METAL ROOFING SYSTEMS**

**PETERSEN ALUMINUM CORP.
SNAP CLAD STANDING SEAM ROOF PANEL
12" WIDE X 0.040" ALUMINUM**


FOR

PETERSEN ALUMINUM CORP.
1005 TONNE RD.
ELK GROVE VILLAGE, IL 60007

Report Prepared By:

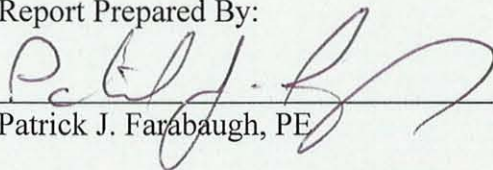

Patrick J. Farabaugh, PE

Reviewed and Approved By:

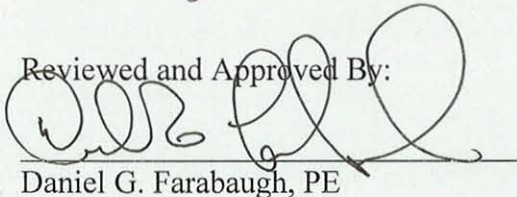
Daniel G. Farabaugh, PE

DANIEL G. FARABAUGH, P.E.
255 Saunders Station Rd.
Trafford, PA 15085
(412) 373-9238

401 Wide Drive • McKeesport, PA 15135
(412) 751-4001 • FAX (412) 751-4003

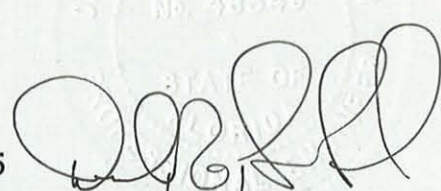

8/23/06

Project No. T207-06

TAS 125-03
STANDARD REQUIREMENTS FOR METAL ROOFING SYSTEMS

Purpose

This test method covers the evaluation of a uniform static air pressure test for materials and products used as external components which help maintain the integrity of the building envelope per Florida Testing Application Standard (TAS) 125-03 (per ASTM E 1592-01) and as provided herein.

Test Date

5-25-06 Test #1 (5 Spans @ 2' oc)
6-6-06 Test #2 (10 Spans @ 1' oc)

Test Specimen

Manufacturer: Petersen Aluminum Corp.
1005 Tonne Rd.
Elk Grove Village, IL 60007

Specimen: SNAP CLAD Standing Seam Roof Panel, 0.040" aluminum (0.038" measured thickness), 12" wide

Panel Length: as shown

Testing Apparatus

Test Chamber: Vacuum Chamber Composed of Wood

Mounting Frame: Hat Shape Subgirts fastened to W6 X 15 Wide Flange Beams

Pressure Indicator: Digital Pressure Manometers

Caliper: Mitutoyo Digital Caliper, Model No. CD-12" CP

Project No. T207-06

Installation

- The panels were installed onto 16 ga supports using Snap Clad Fixed Clips with #12-14 x 1" pancake head self drill fasteners (2 per clip).
- The system was inverted and attached to the steel beams with #14 tek fasteners.
- Plastic (4 mil thick) was employed loosely between the panels and subgirts and in the side joints to create a vacuum seal.

Procedure

- The specimen was checked for proper adjustment and all vents closed in the pressure measuring lines.
- The required deflection measuring apparatus' were installed at their specified locations.
- A nominal initial pressure was applied equal to at least four times but not more than ten times the dead weight of the specimen. This nominal pressure was used as the reference zero and initial deflection readings were recorded.
- At each load increment, pressure was maintained for a period of not less than 60 seconds and until the deflection gages indicated no further increase in deflections.
- Successive increments were achieved as above until failure or ultimate load was reached.

The test was conducted according to the procedure in ASTM E-1592-01 and as noted herein. In our opinion the tape and plastic had no influence on the results of the test.

Project No. T207-06

TEST DATA FOR 12" SNAP CLAD PANEL 0.040" ALUMINUM 5 SPANS @ 2'-0" oc							
DEFLECTION POINT READINGS (INCHES)							REMARKS
LOAD (PSF)	D1	D2	D3	D4	D5	D6	
0.8	0	0	0	0	0	0	PANEL WT.
11.2	0.014	0.113	0.018	0.115	0.008	0.092	
0.8	-0.005	0.012	0.007	0.001	0.005	-0.002	PANEL WT.
16.4	0.016	0.169	0.022	0.173	0.01	0.169	
0.8	-0.004	0.016	0.012	0.012	0.003	-0.004	PANEL WT.
21.6	0.025	0.232	0.031	0.241	0.014	0.22	
0.8	0.003	0.017	0.009	0.012	0.007	-0.002	PANEL WT.
26.8	0.027	0.335	0.043	0.285	0.021	0.285	
0.8	0.002	0.019	0.013	0.014	0.001	0	PANEL WT.
32.0	0.035	0.403	0.048	0.362	0.023	0.387	
0.8	-0.004	0.019	0.007	0.019	0	0.007	PANEL WT.
37.2	0.046	0.473	0.061	0.433	0.036	0.499	
0.8	0	0.024	0.013	0.024	0.008	0.005	PANEL WT.
47.6	0.057	0.668	0.078	0.614	0.044	0.663	
0.8	-0.001	0.029	0.015	0.029	0.006	0.007	PANEL WT.
58.1	0.067	0.875	0.101	0.826	0.068	0.881	
0.8	-0.002	0.029	0.016	0.054	0.007	0.023	PANEL WT.
68.5	0.102	1.081	0.105	0.988	0.086	1.079	
0.8	0	0.051	0.004	0.061	0.013	0.037	PANEL WT.
78.9	0.126	1.271	0.137	1.21	0.133	1.313	
0.8	-0.001	0.075	0.009	0.102	0.025	0.066	PANEL WT.


MAXIMUM TEST LOAD = 89.2 PSF (SIDEJOINT DISENGAGEMENT)

Project No. T207-06

TEST DATA FOR 12" SNAP CLAD PANEL 0.040" ALUMINUM 10 SPANS @ 1'-0" oc							
LOAD (PSF)	DEFLECTION POINT READINGS (INCHES)						REMARKS
	D1	D2	D3	D4	D5	D6	
0.8	0	0	0	0	0	0	PANEL WT.
11.2	0.019	0.065	0.002	0.089	0.005	0.08	
0.8	0.005	-0.032	0.001	-0.027	0.001	-0.01	PANEL WT.
21.6	0.029	0.224	0.006	0.244	0.011	0.227	
0.8	0.011	-0.035	0.001	-0.028	0.001	-0.002	PANEL WT.
32.0	0.033	0.355	0.011	0.402	0.015	0.353	
0.8	0.011	-0.034	0.002	-0.016	0.002	-0.002	PANEL WT.
42.4	0.04	0.485	0.016	0.541	0.017	0.512	
0.8	0.007	-0.033	0.004	-0.03	0.004	-0.003	PANEL WT.
52.9	0.05	0.637	0.021	0.709	0.026	0.753	
0.8	0.001	-0.034	0.005	-0.028	0.005	0.013	PANEL WT.
63.3	0.069	0.838	0.026	0.916	0.034	0.848	
0.8	-0.004	-0.017	0.007	-0.005	0.006	0.014	PANEL WT.
73.7	0.082	0.955	0.03	1.067	0.04	1.011	
0.8	-0.009	0.002	0.008	0.017	0.006	0.027	PANEL WT.
84.1	0.089	1.121	0.035	1.239	0.053	1.184	
0.8	-0.012	-0.011	0.009	0.051	0.007	0.043	PANEL WT.
94.5	0.099	1.353	0.04	1.438	0.069	1.404	
0.8	0.009	0.043	0.011	0.088	0.009	0.08	PANEL WT.
104.9	0.111	1.604	0.048	1.706	0.096	1.681	
0.8	0.005	0.098	0.01	0.169	0.011	0.137	PANEL WT.

MAXIMUM TEST LOAD = 115.2 PSF (SIDEJOINT DISENGAGEMENT)

Project No. T207-06

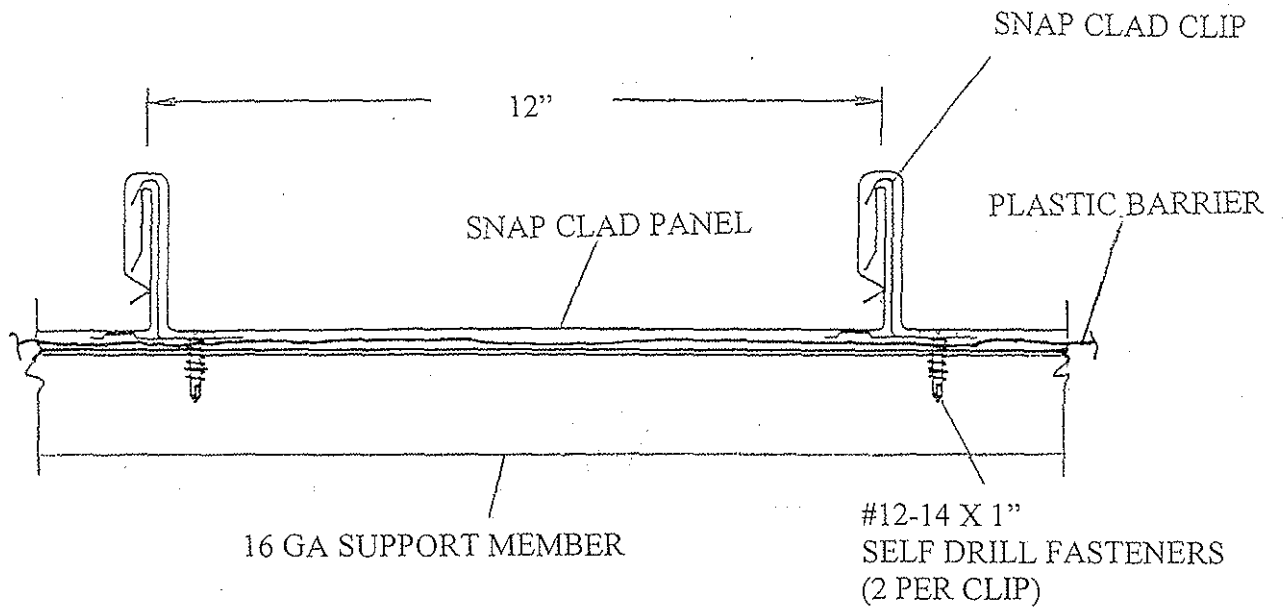

ASSEMBLY DETAIL