

TELEPHONE (AREA CODE 214)

565-0593
565-0594
421-1400

CABLE ADDRESS "DALAB"

DALLAS LABORATORIES, INC.

CONSULTANTS AND TECHNOLOGISTS
ANALYTICAL AND RESEARCH CHEMISTS --

CHEMICAL ENGINEERS -- PETROLEUM ENGINEERS

P. O. BOX 152837
1323 WALL ST

DALLAS, TEXAS 75315

MEMBERS

AMERICAN INSTITUTE OF CHEMICAL ENGINEERS
NATIONAL SOCIETY OF PROFESSIONAL ENGINEERS
TEXAS SOCIETY OF PROFESSIONAL ENGINEERS
ASM INTERNATIONAL
SOCIETY OF PETROLEUM ENGINEERS OF AIME

MEMBERS

AMERICAN CHEMICAL SOCIETY
AMERICAN SOCIETY FOR TESTING MATERIAL
AMERICAN NATIONAL STANDARDS INSTITUTE
AMERICAN SOCIETY FOR QUALITY CONTROL

DATE: May 5, 1992

Report #18155

SUBMITTED BY: Petersen Aluminum Corporation
955 Estes Avenue
Elk Grove Village, IL 60007

DATE OF TESTING: April 22, 1992

TESTING FACILITY: The Dallas Laboratories, Inc.
Dallas, Texas

WITNESSED BY:

Yoosef Lavi, P.E. - Lavi & Associates
Andy Wilson - The Dallas Laboratories, Inc.
Larry Warren - The Dallas Laboratories, Inc.

TESTS:

ASTM E 331-86- Standard test method for water penetration of exterior windows, curtain walls and doors by uniform static air pressure difference.

ASTM E283-91- Standard test method for rate of air leakage through exterior windows, curtain walls, and doors.

DESCRIPTION OF UNIT TESTED

Type: Metal deck roof panel
Series: Snap-on Batten Seam
Panel Profile: 18" wide by 1-1/2" high
Overall size: 8'-0" wide by 10'-0" long

Petersen Aluminum Corporation
May 5, 1992
Snap-on Batten Seam
Page Two

Test unit was installed over an 8'-0" wide by 10'-0" long chamber, at a slope of approximately 2:12 in the following sequence.

15/32" plywood decking supported at 24" o.c. was installed as substrate support. Type 30 organic felt as underlayment was installed over the plywood using 3/8" long steel staples. 18" wide by .024" thick panels were attached to the substrate using clips at 24" o.c.. The Clips were made of .050" thick extruded aluminum, and were fastened with 2 No. 10 x 1" long coated steel screws. Details of panel installation, and panel profile are shown in figure No. 1.


SUMMARY OF TEST RESULTS

<u>Title of test</u>	<u>Test Method</u>	<u>Measured</u>
Air Infiltration @ 1.57 psf	ASTM E 283-91	.02CFM/Ft2
Air Infiltration @ 6.24 psf	ASTM E 283-91	.07CFM/Ft2
Air Exfiltration @ 1.57 psf	ASTM E 283-91	.03CFM/Ft2
Air Exfiltration @ 6.24 psf	ASTM E 283-91	.10CFM/Ft2
Water Penetration @ 12.00 psf	ASTM E 331-86	No Leakage

The above test results were obtained using the applicable ASTM test methods.

TEST SUPERVISED BY:

TEST CONDUCTED BY:



Yoosef Lavi, P.E.



Larry Warren

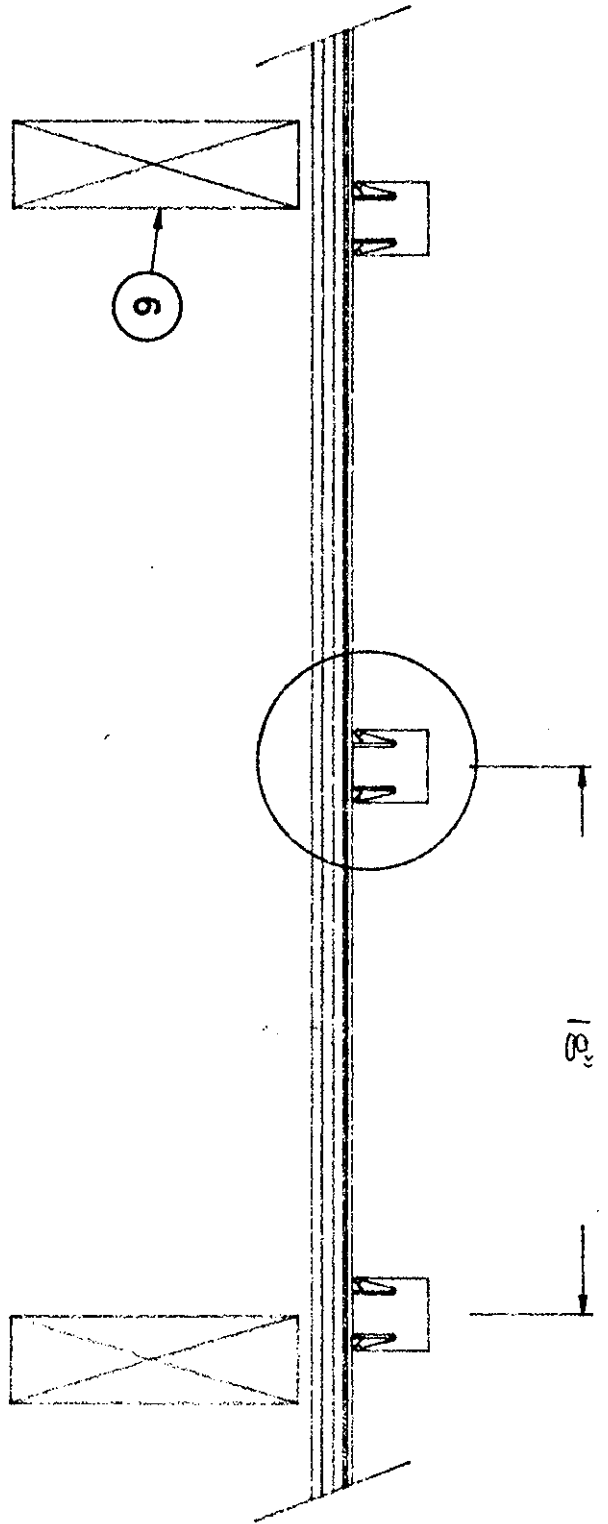
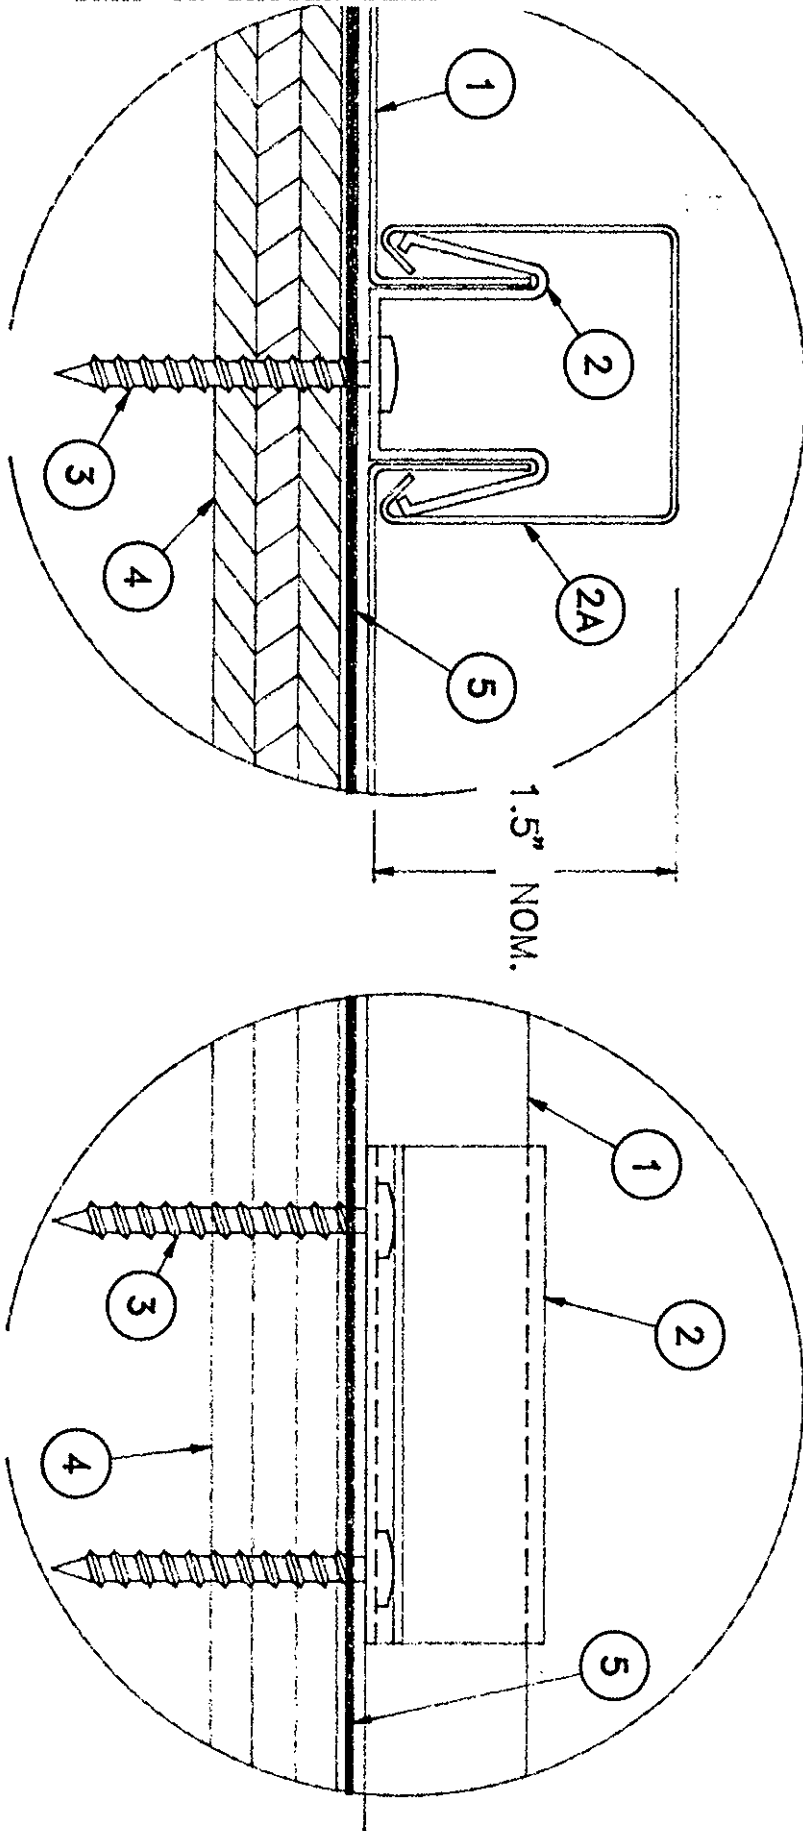


FIGURE NO. 1

Petersen Aluminum Corporation
May 5, 1992
Snap-on Batten Seam
Page Four

FIGURE NO. 1 DESCRIPTIONS

1. Metal roof deck Panels- No. 24 msg coated steel panels, 18 in. wide, 1.5 in. high, with no endlaps.
2. Roof Panel Clips- One piece assembly, 2-1/2 in. wide, 7/8 in. high, .050 in. thick extruded aluminum spaced 24 in. o.c.,
3. Fasteners- Fasteners used to attach panel clips to plywood deck, No. 10 by 1 in. long.
4. Plywood decking- Plywood decking, 15/32 in. thick.
5. Underlayment- Underlayment used over plywood deck was type 30 LB. roofing felt. Felt fastened to plywood deck with staples at random spacing.
6. Supports- spaced at 24 in. o.c..