



RIDGE-LOK INSULATED METAL PANEL OPEN FRAMING DETAILS ENDLAP-OFF MODULE - OPTION 2 DETAIL




ENDLAPS NOT PERMITTED FOR FREEZER APPLICATION

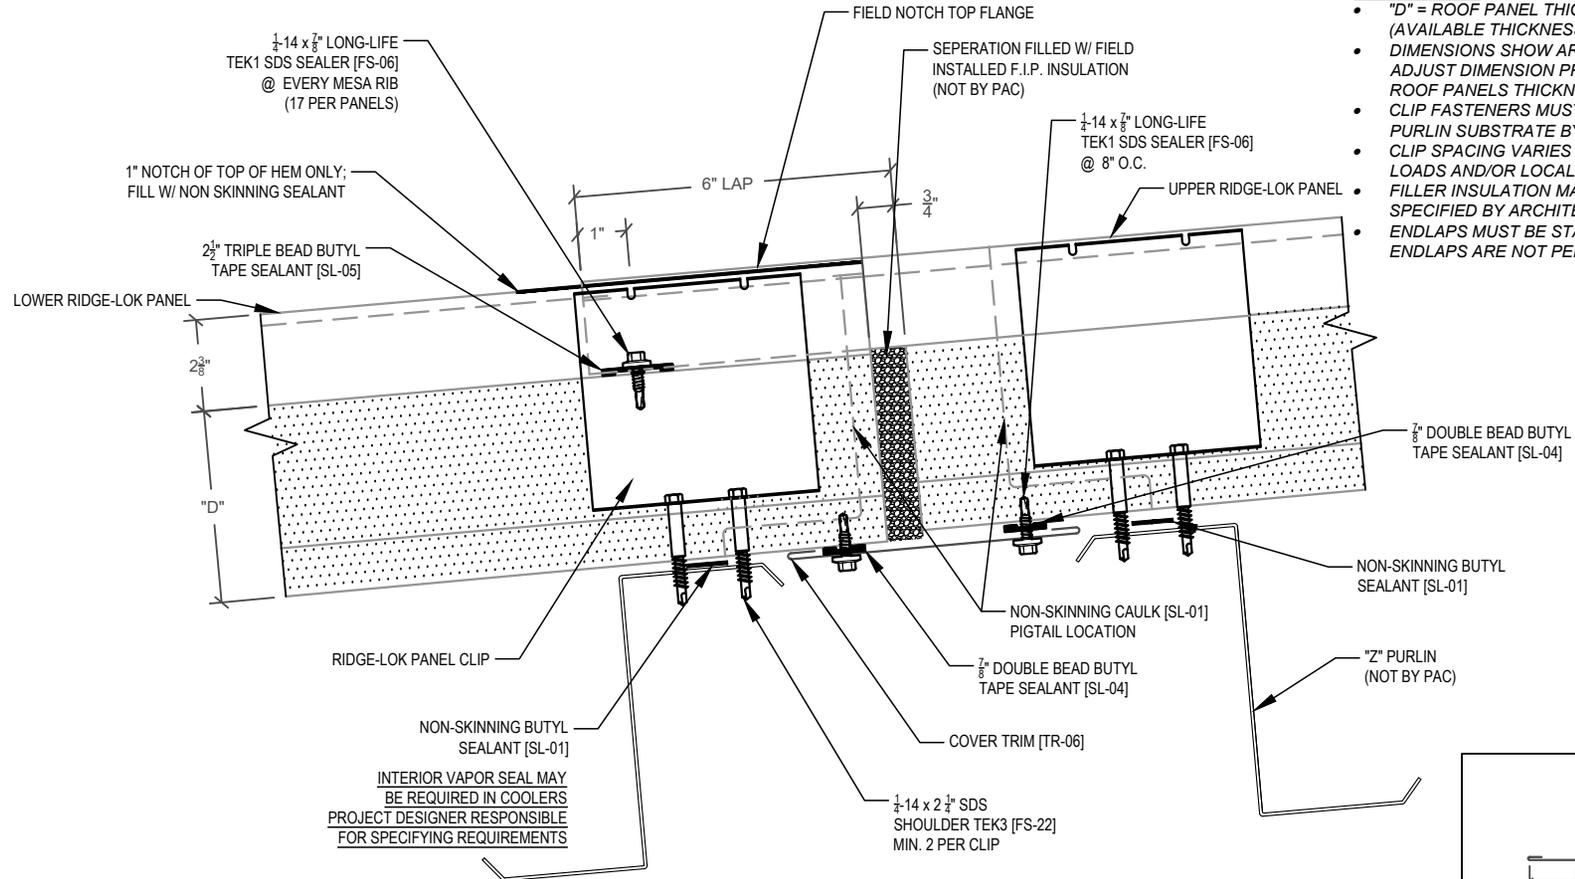


KEYNOTES:

- "D" = ROOF PANEL THICKNESS (AVAILABLE THICKNESS = 2.5", 3", 4", 5" OR 6")
- DIMENSIONS SHOW ARE FOR 4" THICK ROOF PANEL. ADJUST DIMENSION PROPORTIONALLY FOR OTHER ROOF PANELS THICKNESS.
- CLIP FASTENERS MUST PENETRATE TOP FLANGE OF "Z" PURLIN SUBSTRATE BY 5/8" MINIMUM THREAD LENGTH
- CLIP SPACING VARIES BASED ON PROJECT SPECIFIC LOADS AND/OR LOCAL BUILDING CODES
- FILLER INSULATION MATERIAL AND APPLICATION SPECIFIED BY ARCHITECT
- ENDLAPS MUST BE STAGGERED; FOUR CORNER ENDLAPS ARE NOT PERMITTED

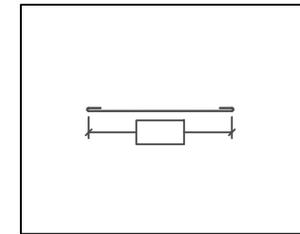

FLASHINGS

SCALE: 3" = 1'-0"



EFFECTIVE DATE: 06-07-2024
SUBJECT TO CHANGE WITHOUT NOTICE

DISCLAIMER: DETAIL SHOWN FOR ILLUSTRATION PURPOSES ONLY. ACTUAL PROJECT DETAIL MAY VARY

RL-CS-EL-002